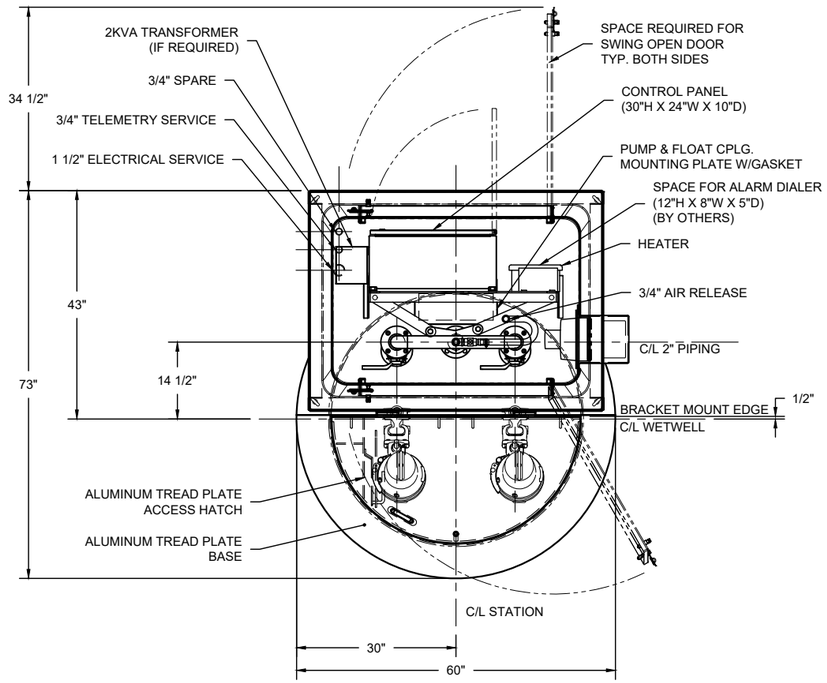

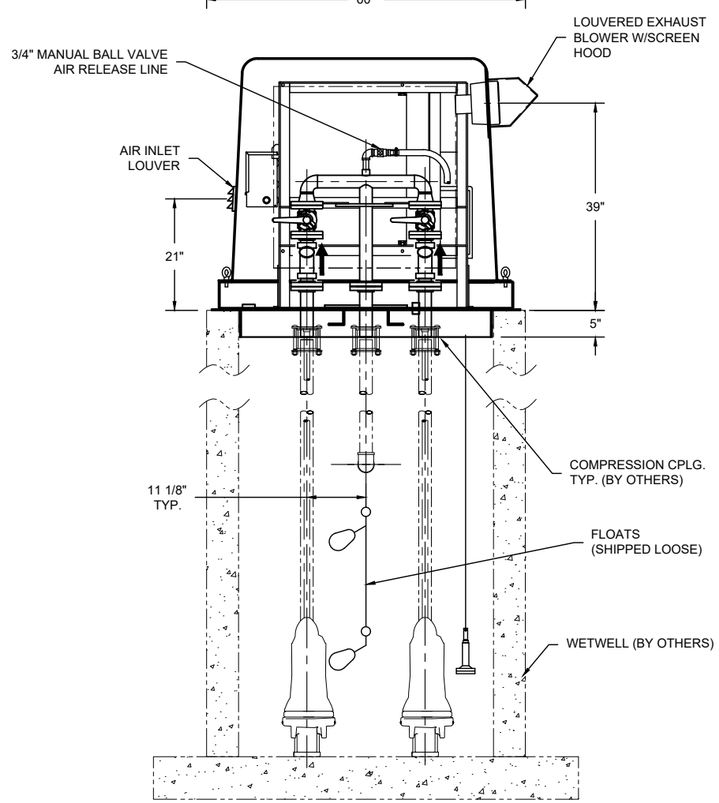

0" 6" 12" 24" 36"

PAINT REQUIREMENTS
PIPING EXTERIOR AND STEEL SURFACES
APPLY 6 MILS EPOXY ENAMEL

CONDUITS REQUIRED:

1 1/2"	ELECTRICAL SERVICE
3/4"	TELEMETRY SERVICE
3/4"	SPARE

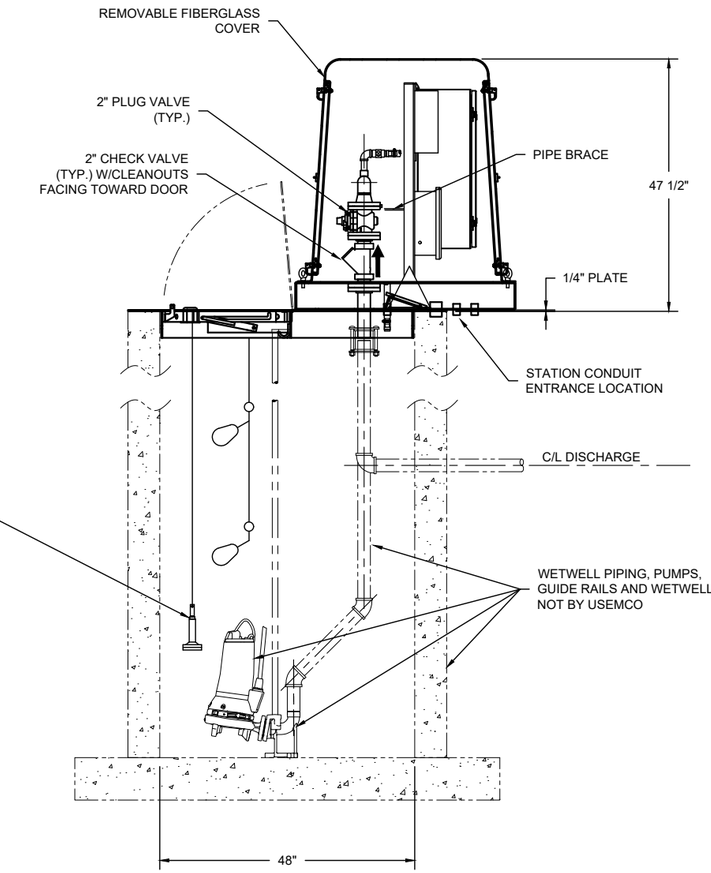

REV. NO.	REVISION	BY CHK'D	DATE

DESIGNED BY:		DATE	
DRAWN BY:	DS	DATE	6/23
CHECKED BY:	BD	DATE	22
SCALE			

USEMCO
USEMCO INCORPORATED
P.O. BOX 550 (608) 372-5911 TOMAH WI. 54660

DESCRIPTION
TOP VAULT
48" WETWELL, 2" PIPING

DWG. NO. 500997.4820
CODE NO. F7