


**PAINT REQUIREMENTS**  
 PIPING EXTERIOR AND STEEL SURFACES  
 APPLY 6 MILS EPOXY ENAMEL

**CONDUITS REQUIRED:**  
 1 1/2" ELECTRICAL SERVICE  
 3/4" TELEMETRY SERVICE  
 3/4" SPARE

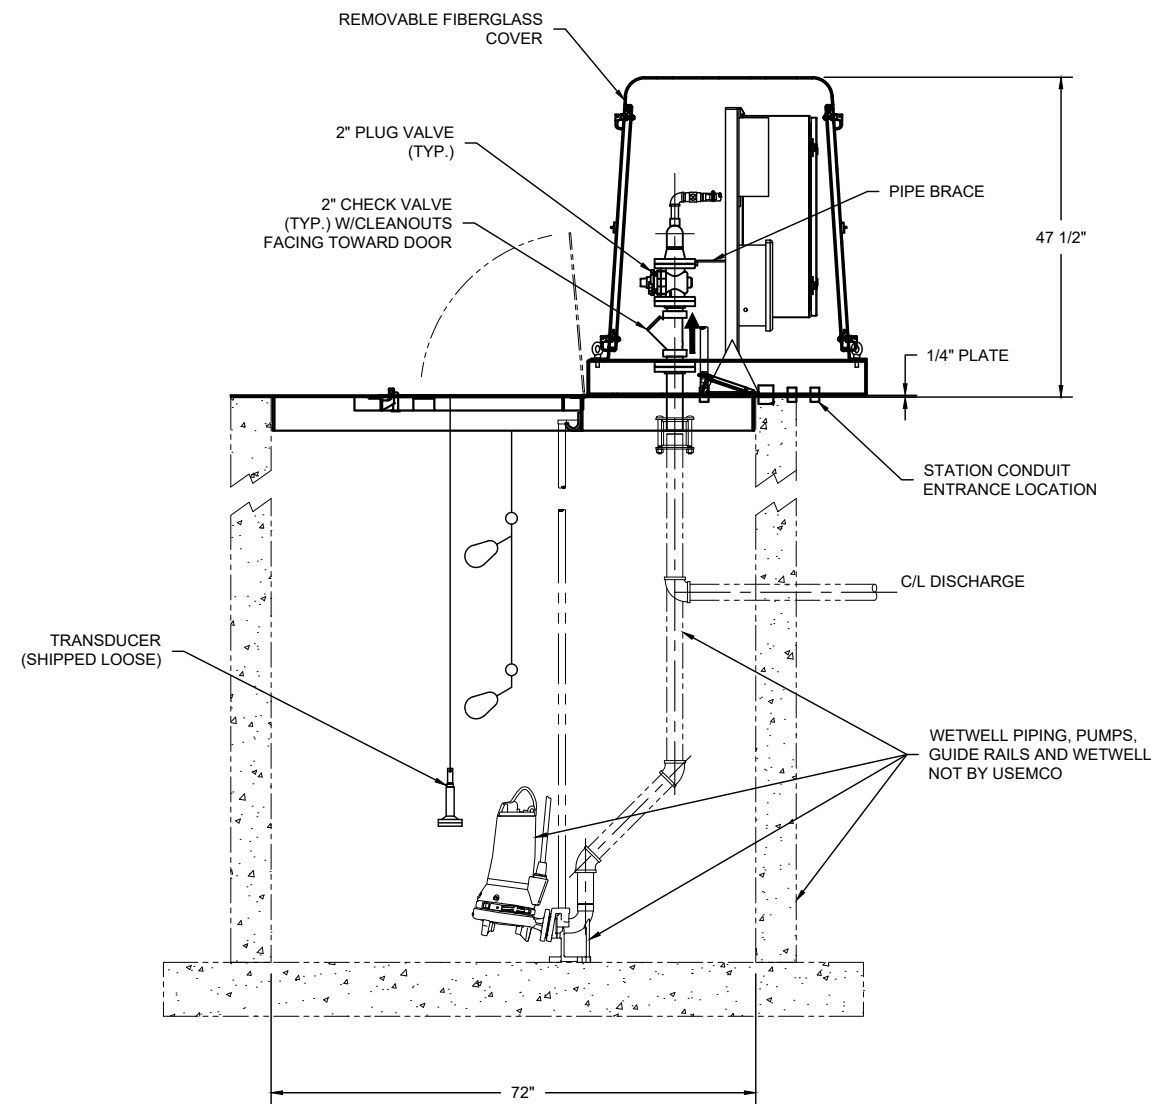

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE
		CHKD		DRAWN BY:	DATE
				DS	6/23
				CHECKED BY:	DATE
				BD	22
				SCALE	

**USEMCO**

USEMCO INCORPORATED

P.O. BOX 550 (608) 372-5911 TOMAH WI. 54660

**TOP VAULT**

**72" WETWELL, 2" PIPING**

DWG. NO. 500997.7220

CODE NO. F7