
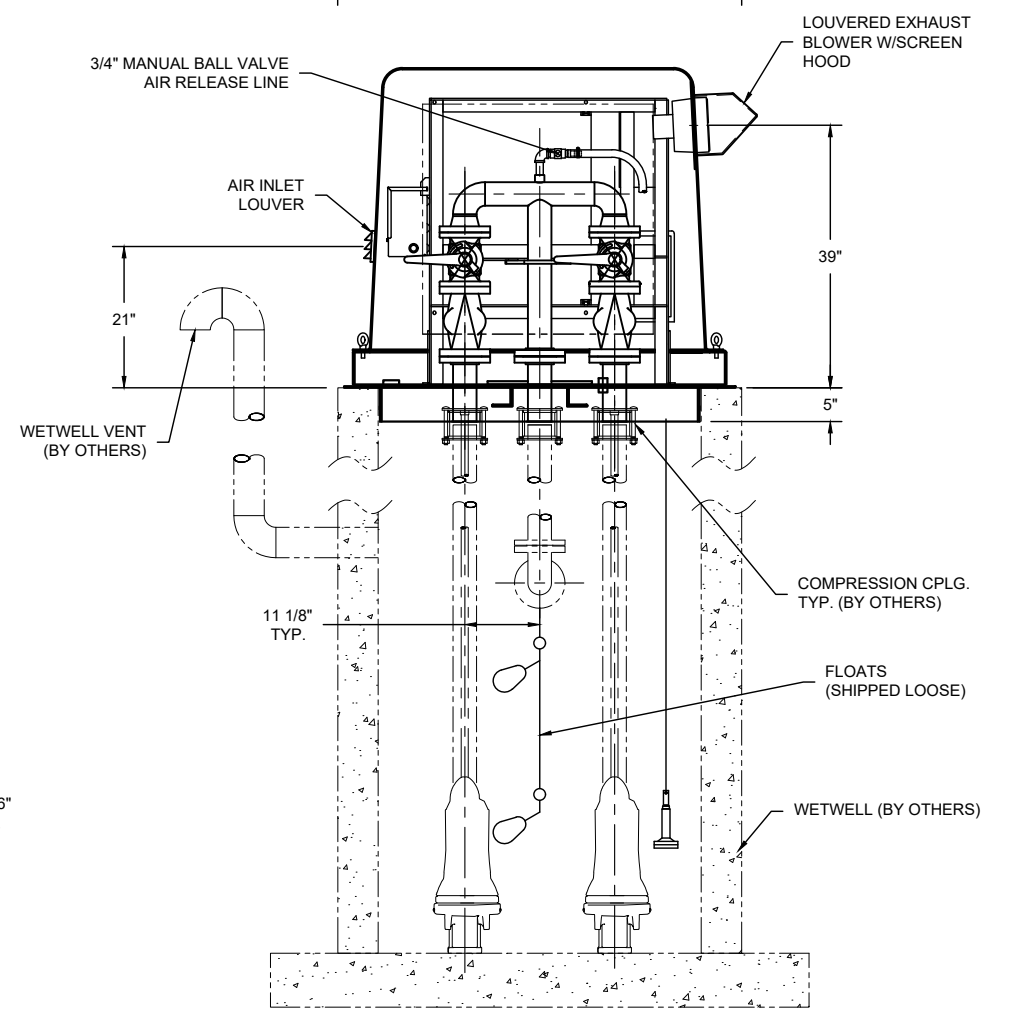
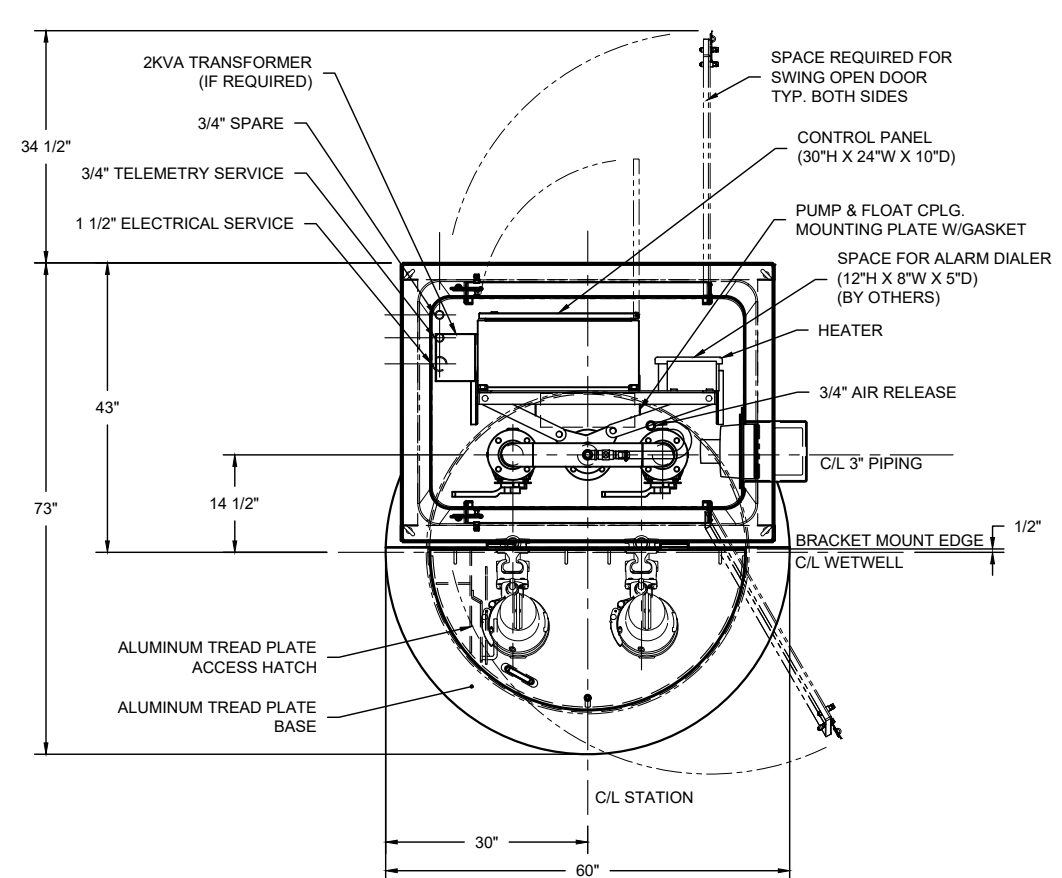


PAINT REQUIREMENTS
PIPING EXTERIOR AND STEEL SURFACES
APPLY 6 MILS EPOXY ENAMEL

CONDUITS REQUIRED:
1 1/2" ELECTRICAL SERVICE
3/4" TELEMETRY SERVICE
3/4" SPARE

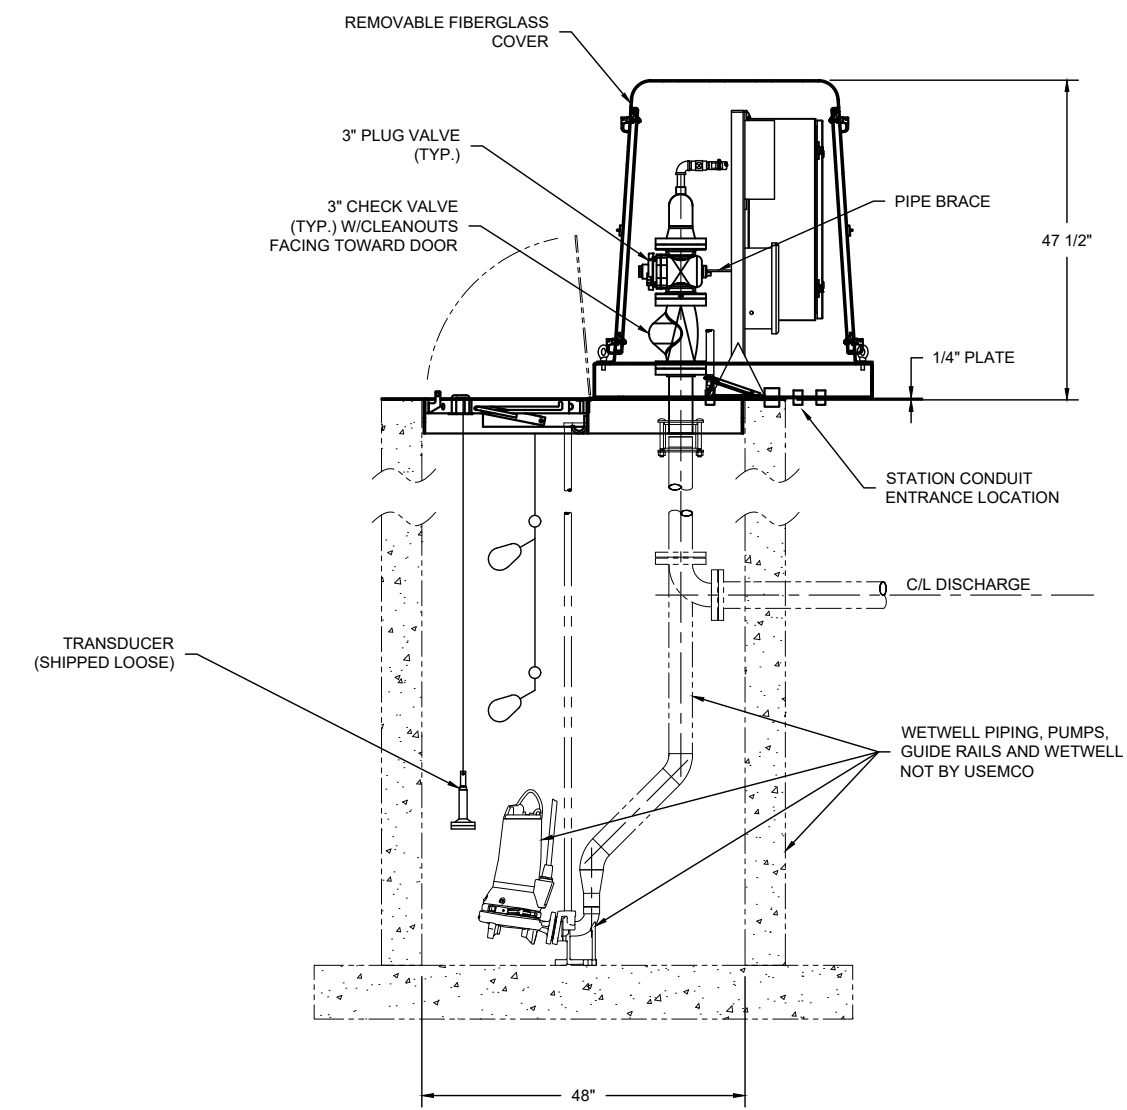

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	USEMCO USEMCO INCORPORATED P.O. BOX 550 (608) 372-5911 TOMAH WI. 54660 DESCRIPTION TOP VAULT 48" WETWELL, 3" PIPING DWG. NO. 500997.4830 CODE NO. F7
		CHKD		DRAWN BY:	DATE	
				DS	6/23	
				CHECKED BY:	DATE	
				BD	22	
				SCALE		