
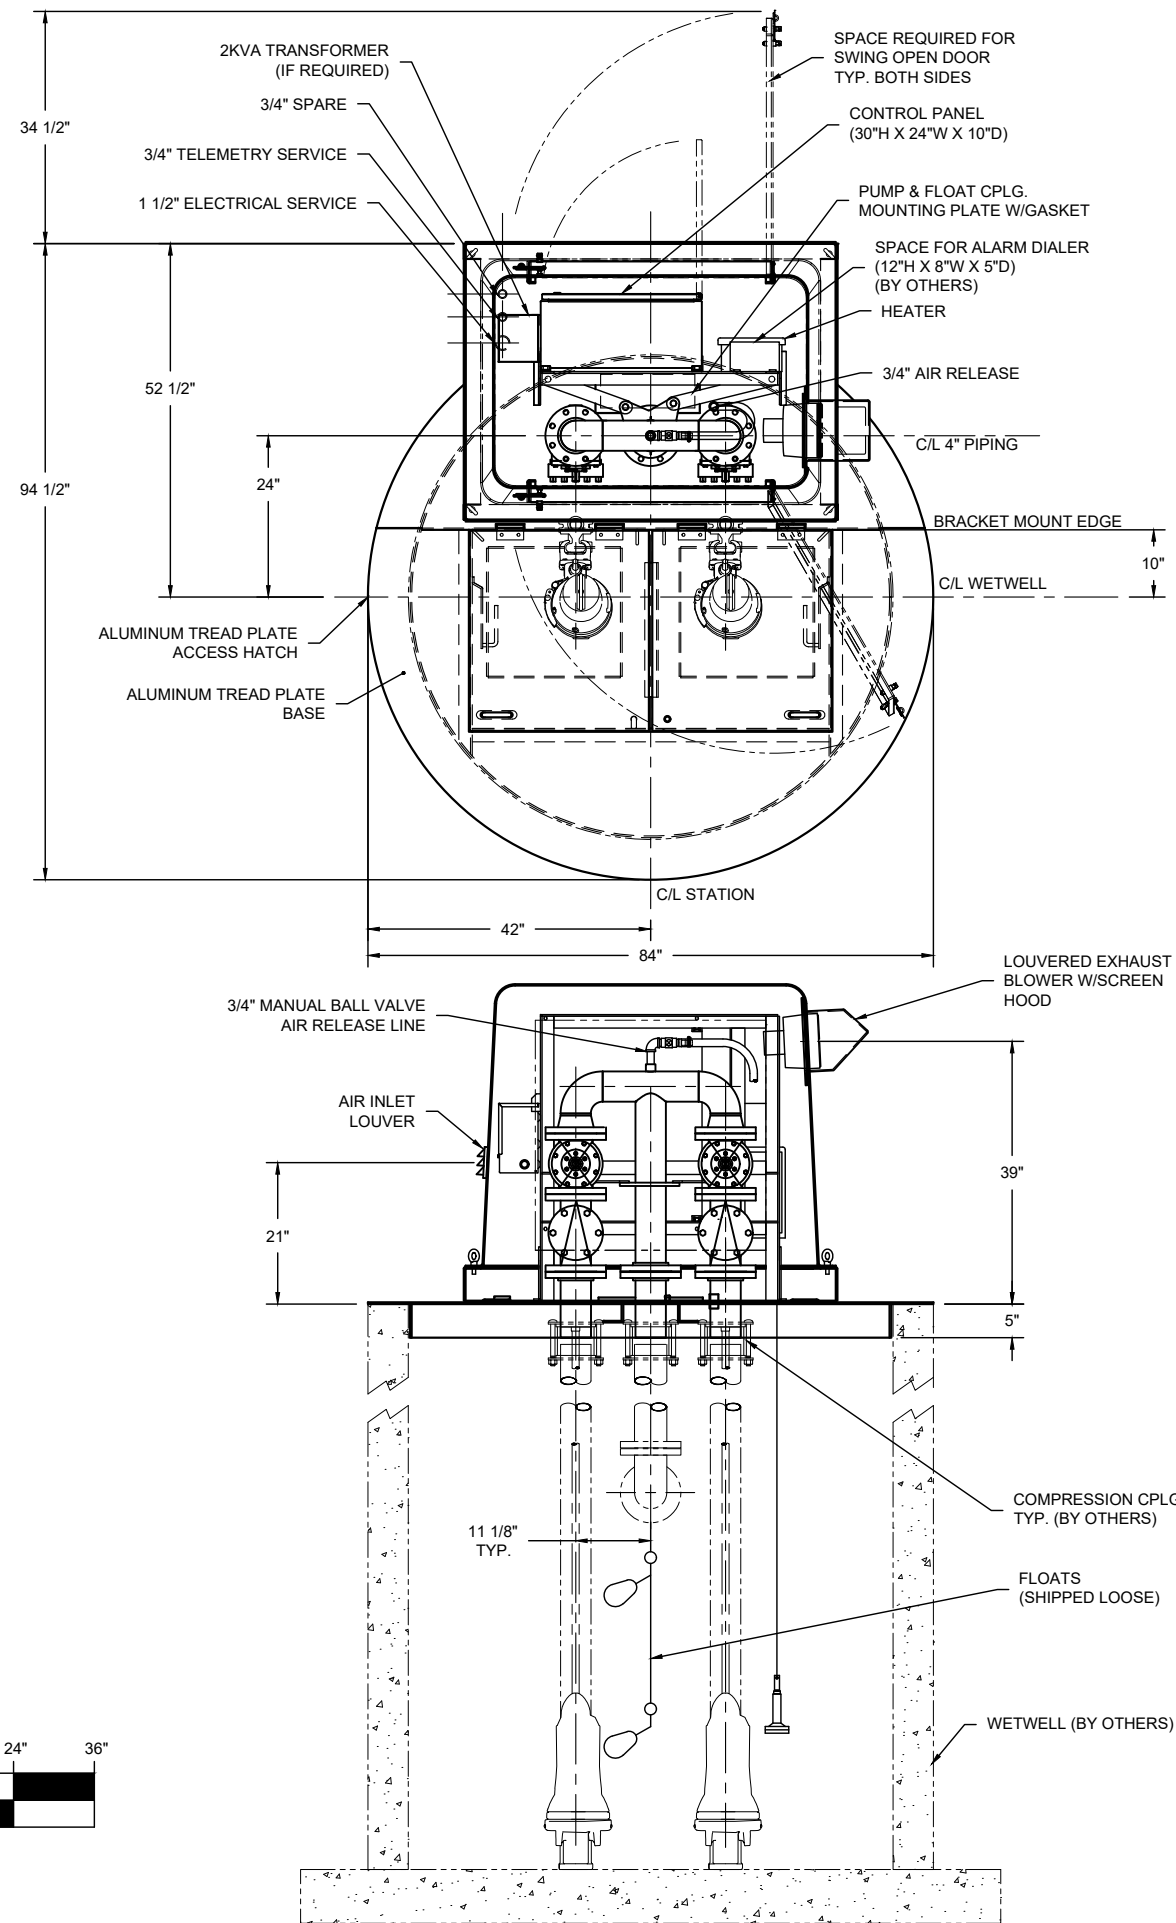


CONDUITS REQUIRED:
 1 1/2" ELECTRICAL SERVICE
 3/4" TELEMETRY SERVICE
 3/4" SPARE

PAINT REQUIREMENTS
 PIPING EXTERIOR AND STEEL SURFACES
 APPLY 6 MILS EPOXY ENAMEL

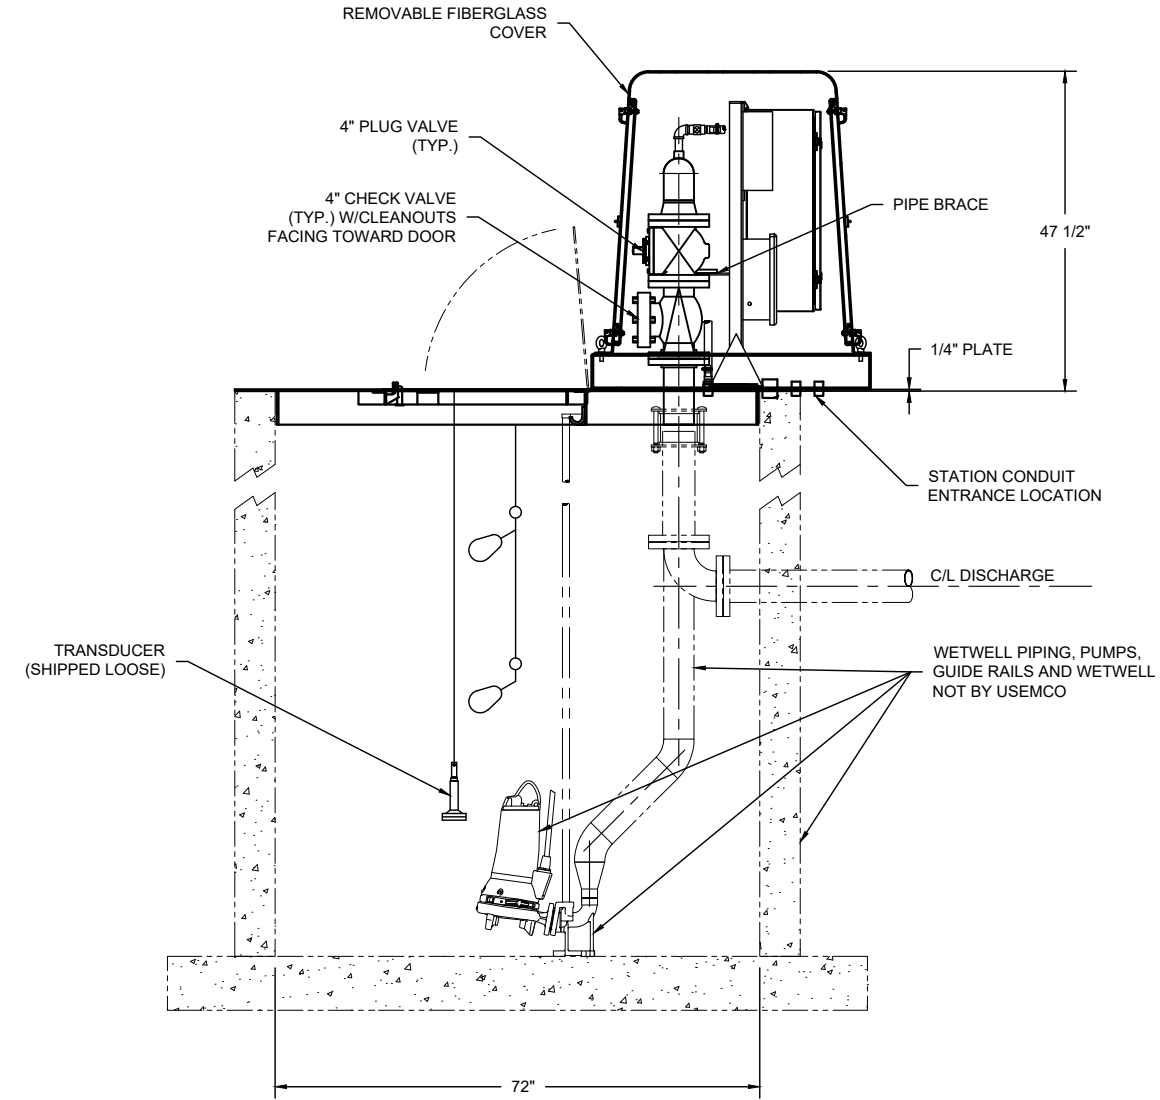

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	USEMCO USEMCO INCORPORATED P.O. BOX 550 (608) 372-5911 TOMAH WI. 54660	
		CHKD		DRAWN BY:	DATE		
				DS	6/23	DESCRIPTION TOP VAULT 72" WETWELL, 4" PIPING	
				CHECKED BY:	DATE		
				BD	22	DWG. NO. 500997.7240	
				SCALE			
						CODE NO. F7	